



Grant Pre Plumbed Monowave 200 Ltr B-Rated

Addendum Installation and Servicing Instructions

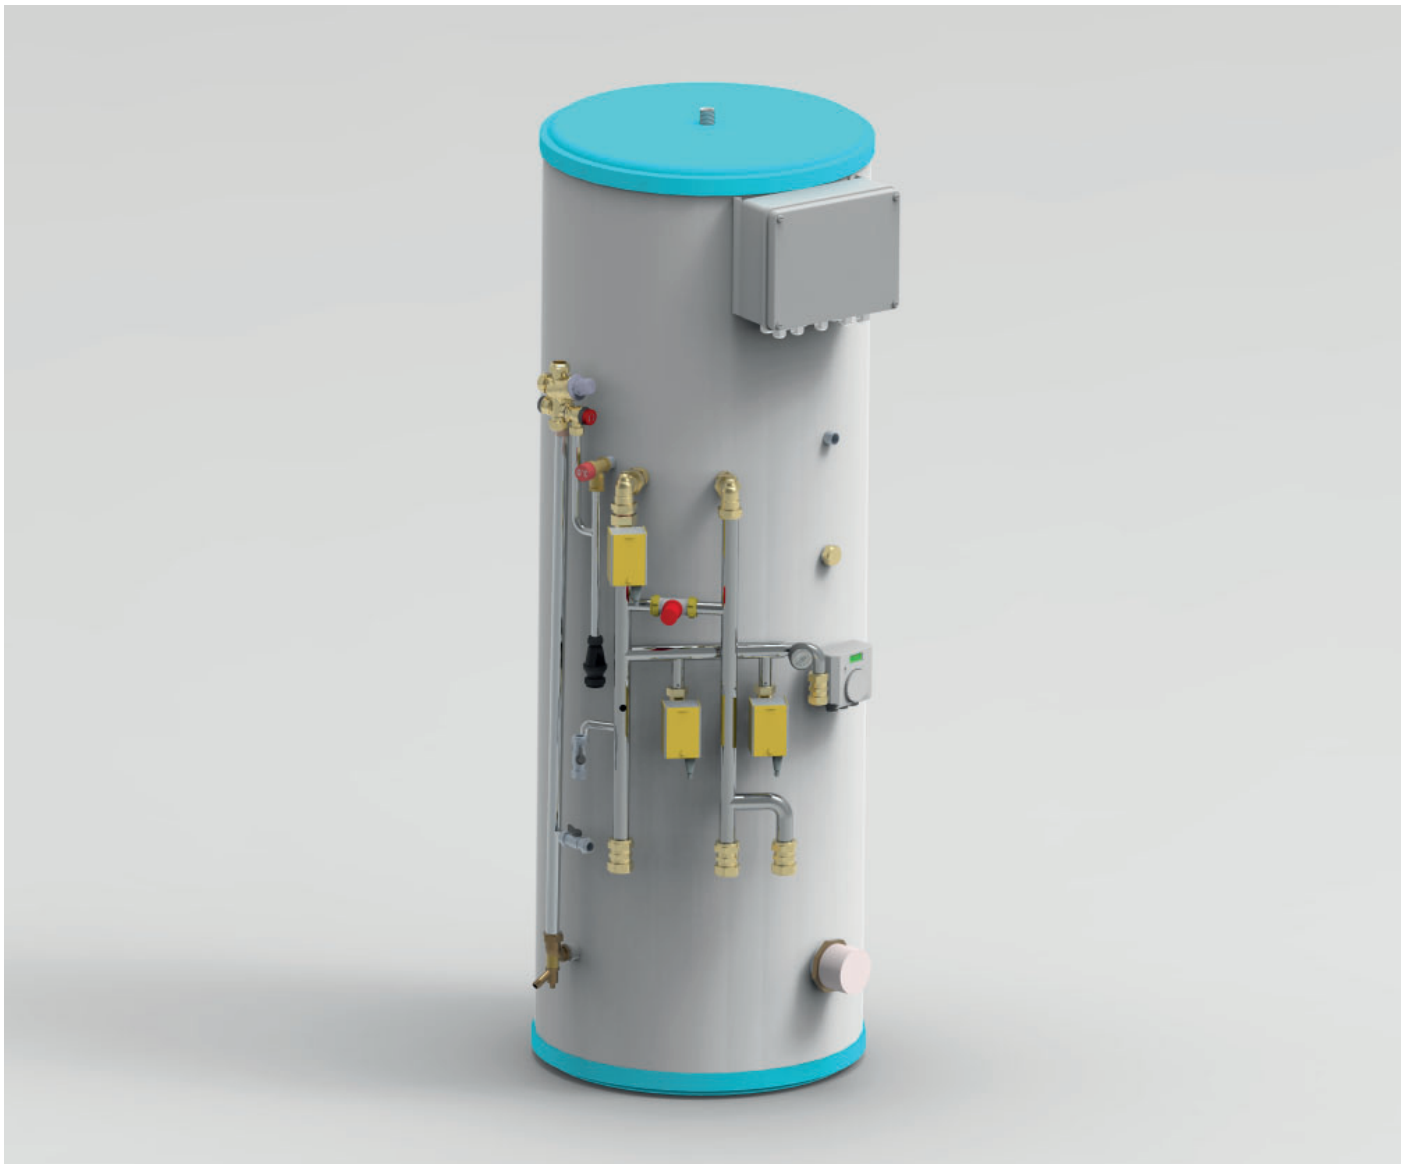

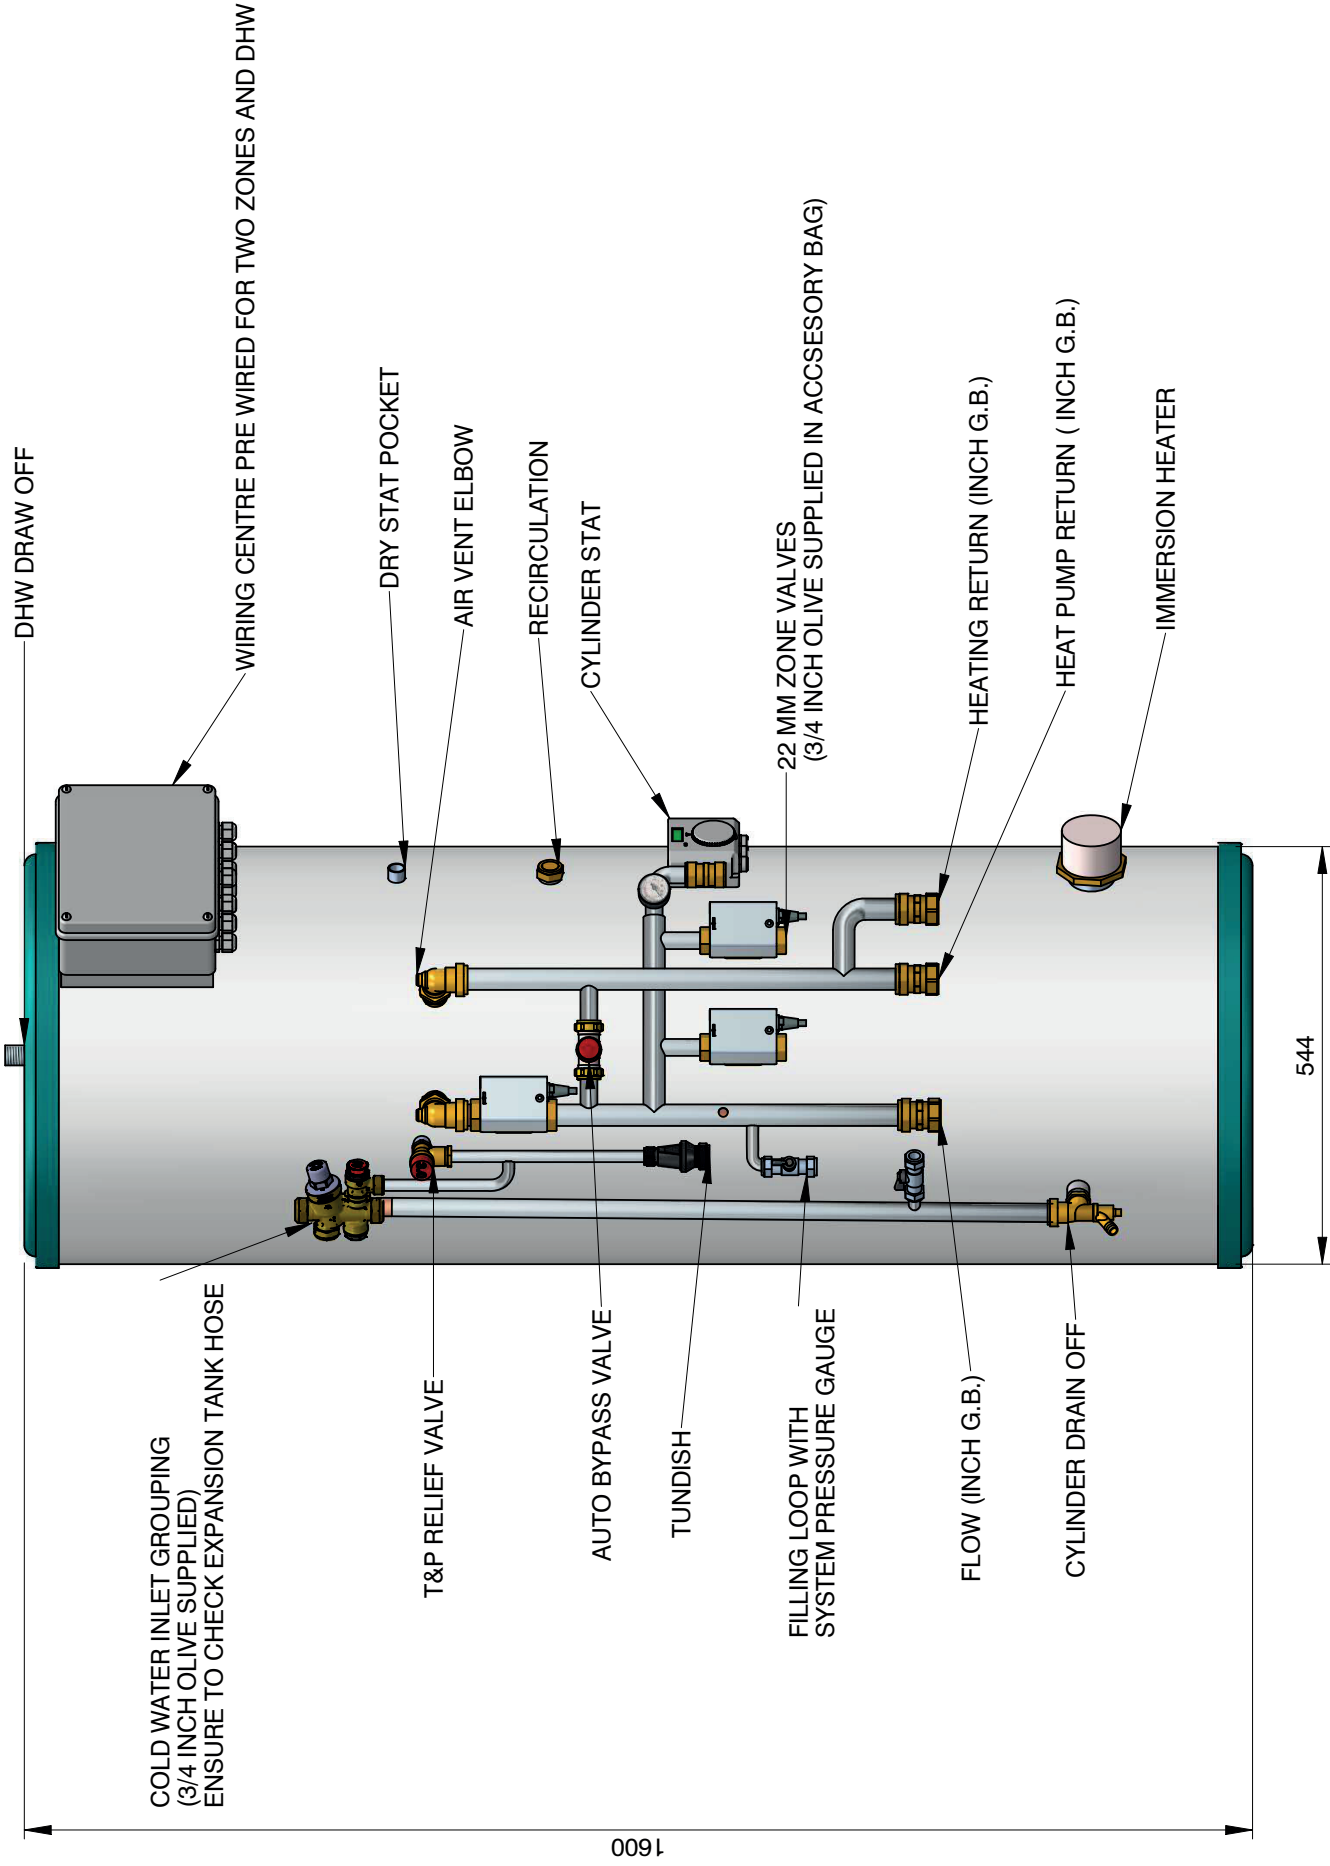

DHW DRAW OFF

WIRING CENTRE PRE WIRED FOR TWO ZONES AND DHW

DRY STAT POCKET

AIR VENT ELBOW

RECIRCULATION

CYLINDER STAT

22 MM ZONE VALVES
(3/4 INCH OLIVE SUPPLIED IN ACCESSORY BAG)

HEATING RETURN (INCH G.B.)

HEAT PUMP RETURN (INCH G.B.)

IMMERSION HEATER

COLD WATER INLET GROUPING
(3/4 INCH OLIVE SUPPLIED)
ENSURE TO CHECK EXPANSION TANK HOSE

T&P RELIEF VALVE

AUTO BYPASS VALVE

TUNDISH

FILLING LOOP WITH
SYSTEM PRESSURE GAUGE

FLOW (INCH G.B.)

CYLINDER DRAIN OFF


544

1600

GRANT WIRING DIAGRAM-AERONA-UFH-RADS & DHW STAT CONTROL

GRANT AERONA
HEATPUMP

HOT WATER PRIORITY ON/OFF

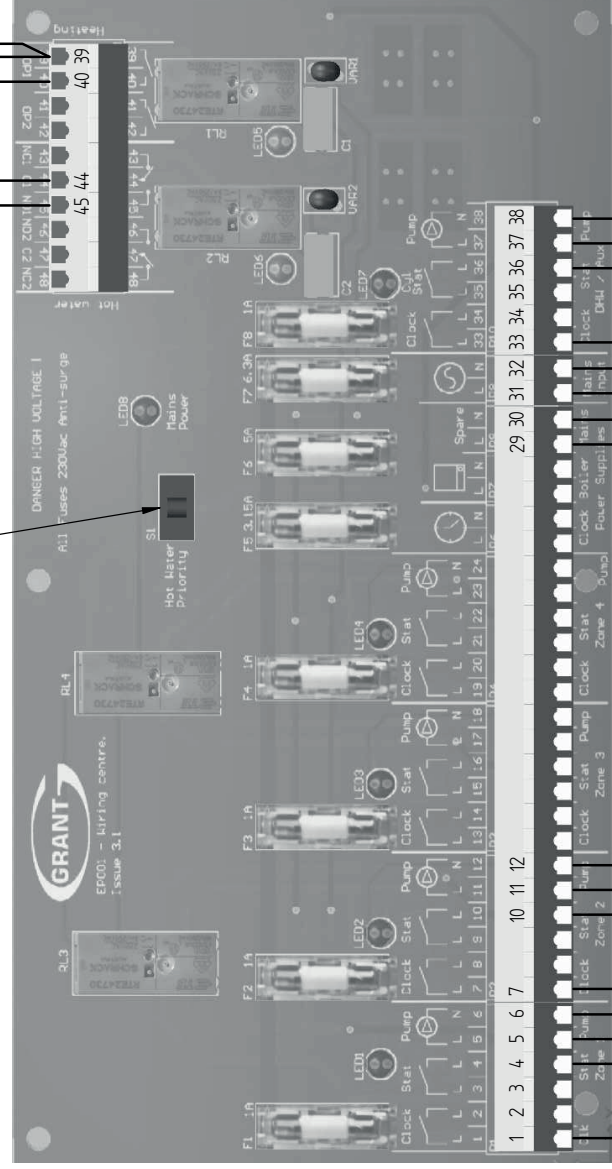

- ZONE 1: 1-6
- ZONE 2: 7-12
- ZONE 3: 13-18
- ZONE 4: 19-24
- DHW : 33-38

FOR ADDITIONAL UFH WIRING CENTRES RAD ZONES
USE ZONE 3,4 ETC.

NEUTRAL
LIVE

NEUTRAL
LIVE
LOAD
COMMON

DHW
MOTORIZED
VALVE OR PUMP

RAD ZONE
MOTORIZED
VALVE OR PUMP

UFH
MOTORIZED
VALVE OR PUMP


EARTH WIRES OMITTED FOR CLARITY

HEATING ENABLE
UFH WIRING CENTRE

RADIATOR
ZONE STAT

NEUTRAL
CYLINDER
STAT

GRANT WIRING DIAGRAM-AERONA-UFH & DHW STAT CONTROL




GRANT AERONA
HEATPUMP





- ZONE 1: 1-6
- ZONE 2: 7-12
- ZONE 3: 13-18
- ZONE 4: 19-24
- DHW : 33-38

FOR ADDITIONAL UFH WIRING CENTRES RAD ZONES
USE ZONE 3,4 ETC.

HOT WATER PRIORITY ON/OFF

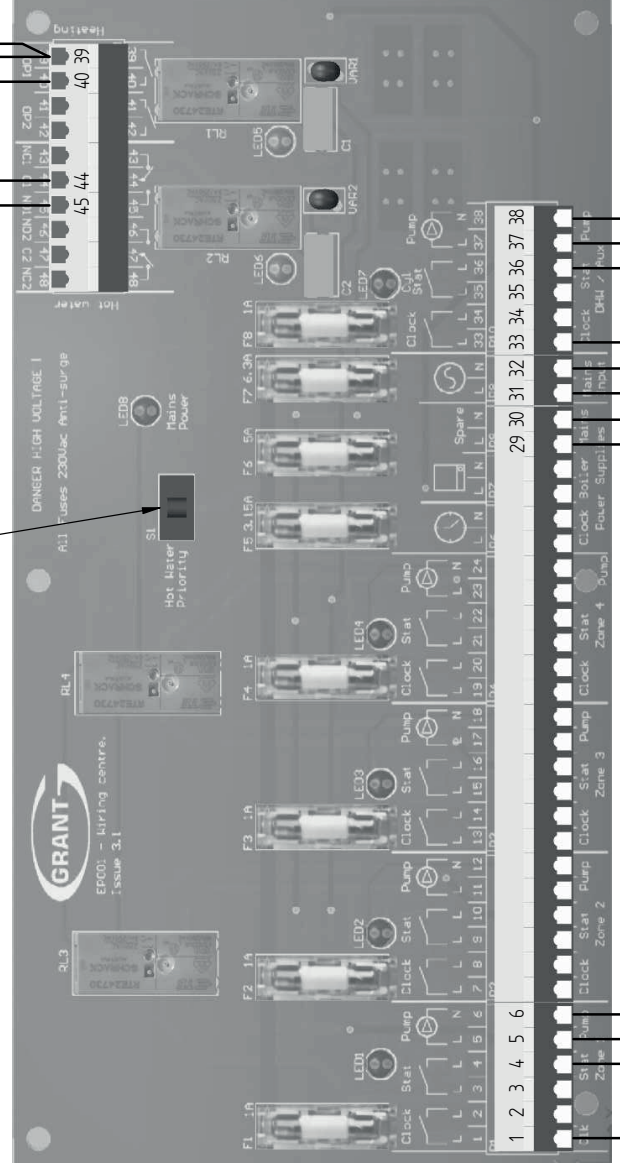


NEUTRAL
LIVE
MAINS INPUT

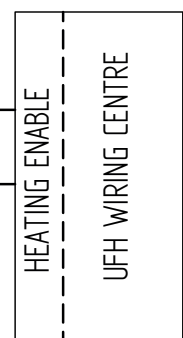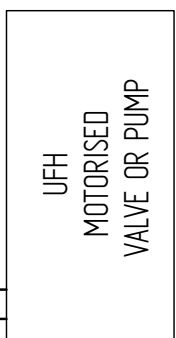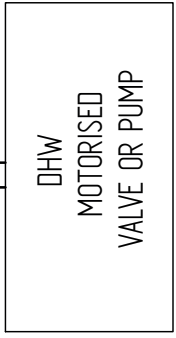

EARTH WIRES OMITTED FOR CLARITY


GRANT WIRING DIAGRAM-AERONA-RADS & DHW






- ZONE 1: 1-6
- ZONE 2: 7-12
- ZONE 3: 13-18
- ZONE 4: 19-24
- DHW :33-38

FOR ADDITIONAL RAD ZONES
USE ZONE 3,4 ETC.

HOT WATER PRIORITY ON/OFF

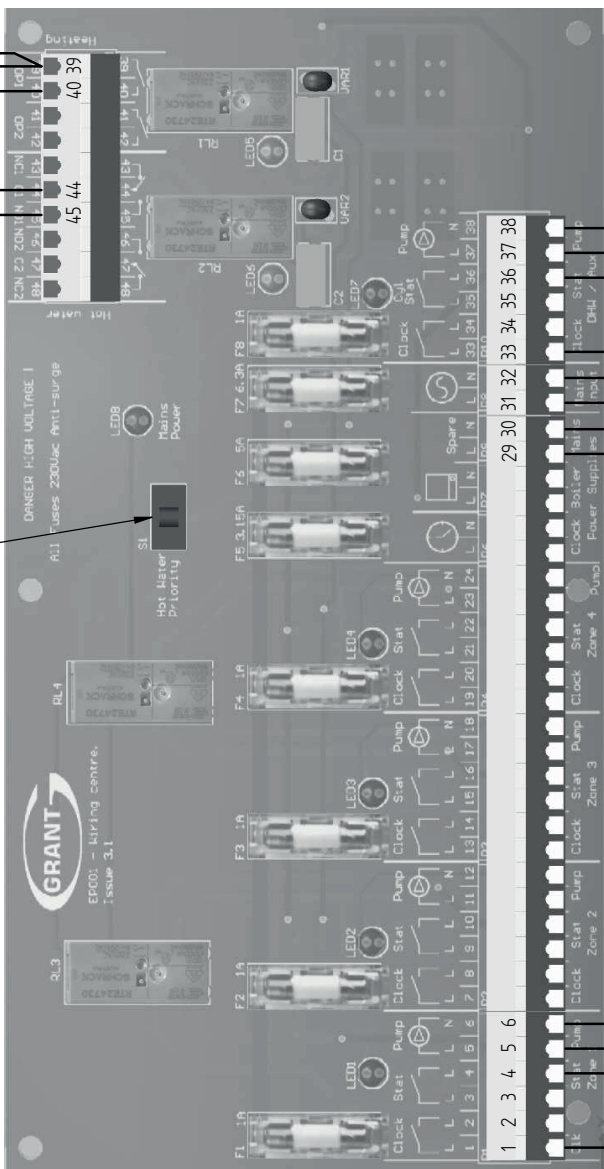


NEUTRAL
LIVE

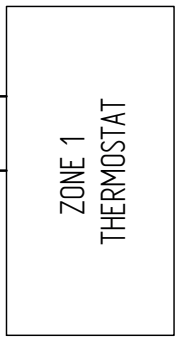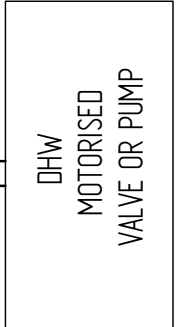

EARTH WIRES OMITTED FOR CLARITY

GRANT WIRING DIAGRAM-AERONA-TIME-CLOCK-CONTROL-RADS & DHW




GRANT AERONA
HEATPUMP


- ZONE 1: 1-6
- ZONE 2: 7-12
- ZONE 3: 13-18
- ZONE 4: 19-24
- DHW : 33-38

FOR ADDITIONAL RAD ZONES
USE ZONE 3,4 ETC.

HOT WATER PRIORITY ON/OFF

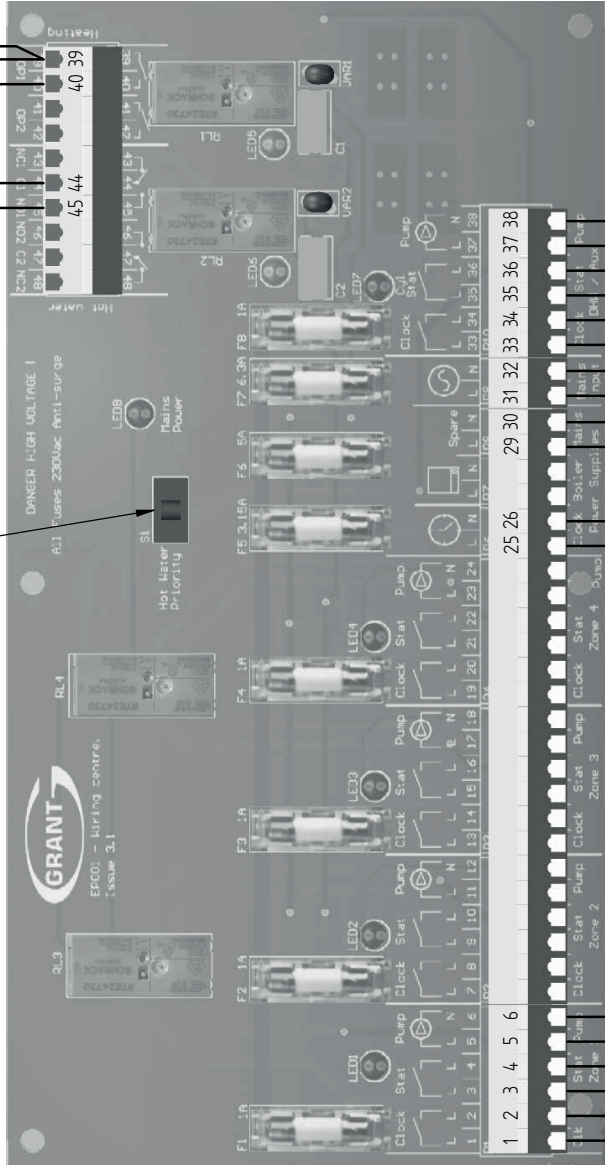

NEUTRAL
LIVE
MAINS INPUT

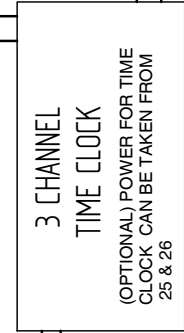

EARTH WIRES OMITTED FOR CLARITY

Accessory Bag Contents

- 7 3/4" Olives
- 2 3/4" Nuts
- 1 24 Ltr Potable Expansion Tank
- 1 Blanking Cap for inlet grouping
- 1 Grant Monowave Cylinder Manual



GRANT ENGINEERING (IRELAND) LTD

Crinkle, Birr, Co. Offaly, R42 D788, Ireland

Tel: +353 (057) 912 0089 Fax: +353 (057) 912 1060

Email: info@grantengineering.ie www.grantengineering.ie